


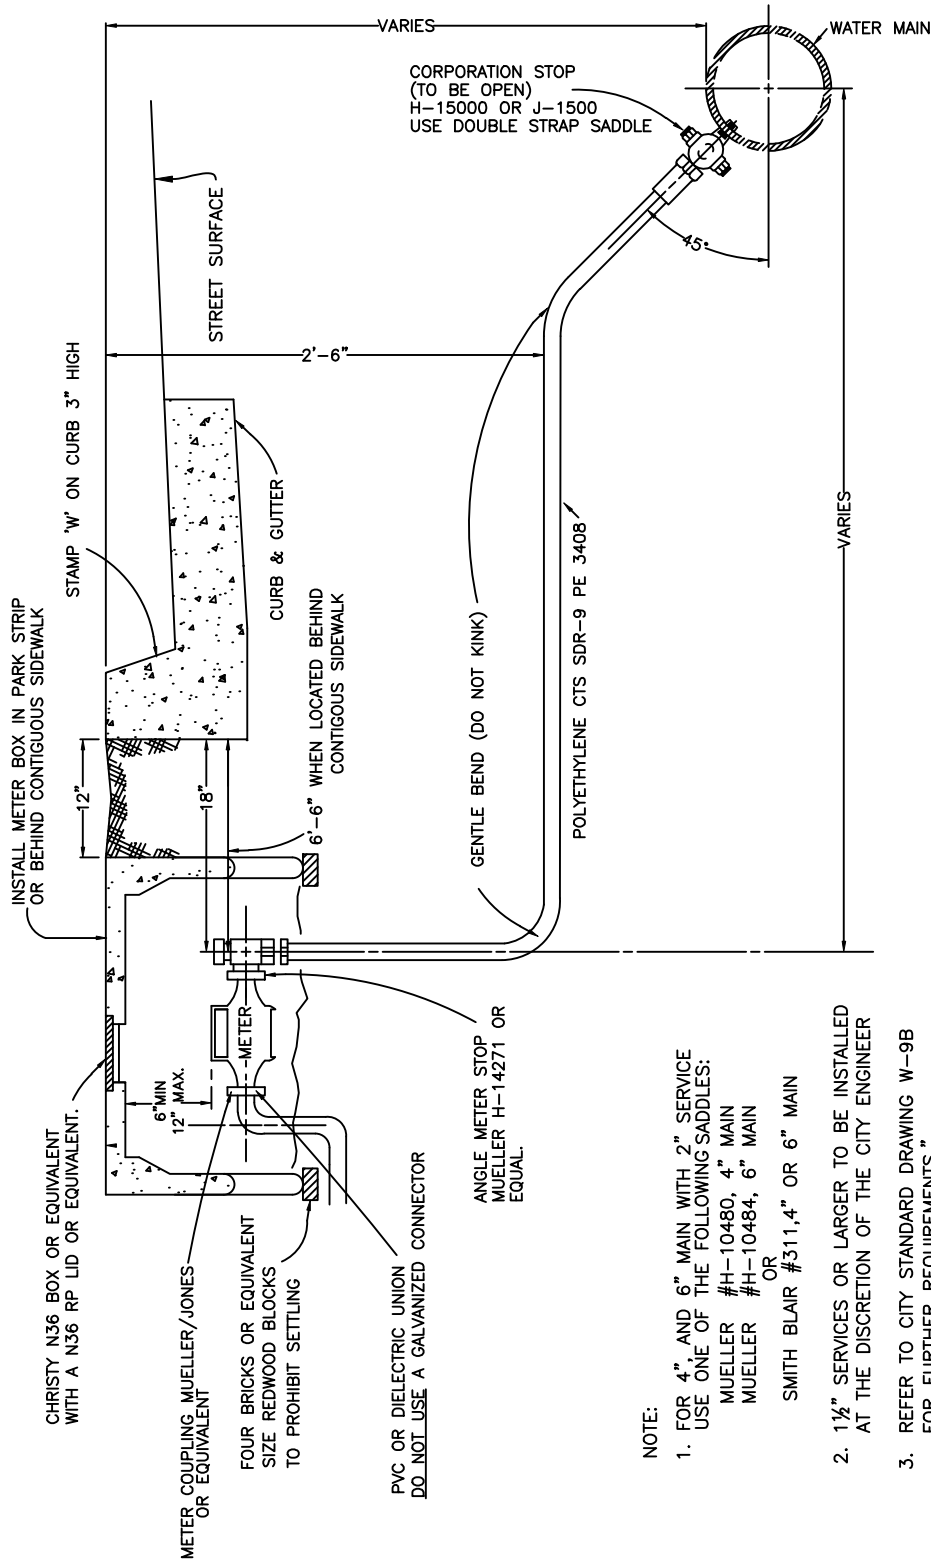

NOTE:

1. FOR 4", AND 6" MAIN WITH 2" SERVICE USE ONE OF THE FOLLOWING SADDLES:
MUELLER #H-10480, 4" MAIN
MUELLER #H-10484, 6" MAIN
OR
SMITH BLAIR #311,4" OR 6" MAIN
2. 1½" SERVICES OR LARGER TO BE INSTALLED AT THE DISCRETION OF THE CITY ENGINEER
3. REFER TO CITY STANDARD DRAWING W-9B FOR FURTHER REQUIREMENTS.
4. POLYETHYLENE PIPE SHALL USE CAMPAK COMPRESSION-TYPE JOINTS WITH STAINLESS STEEL INSERT

1-1/2" & 2" SERVICE CONNECTION & METER BOX INSTALLATION

REF. & REV.
MAR. 2005
AUG. 2008
SEPT. 2009
FEB. 2016
OCT. 2023

CITY OF MADERA

W-10